

Content

Time delay relays pluggable

Multifunctional time delay relay MFT SU22S, MFT SU22P	2.2
Multifunctional time delay relay MFT U31S, MFT U41SE	2.6
Multifunctional clock-pulse generator relay MFT ST22S	2.12
Multifunctional clock-pulse generator relay MFT T51SE	2.16
Delay off without supply voltage MFT SA23S	2.20
Star-delta relay MFT SS22S	2.24
Accessories time delay relays	2.28
Plug in socket	2.28
External potentiometer	2.28
Technical safety advice	2.29
Prescriptions and standards	2.30

Multifunctional time delay relay

MFT SU22S, MFT SU22P



MFT SU22S

- **7 Functions, 7 time ranges**
- **Multivoltage:**
12 ... 240 Vac / dc
- **2 output contacts**

Functions

- E** Delay on
- E** Delay on - version with control contact as opening contact
- A** Delay off
- I2** Pulse extension with control contact
- W2** Wiping on trailing edge
- E1** Delay on with control contact
- I1** Pulse limitation timer voltage control
- B2** Cycling timer starting on a pause

Time end ranges

Adjustment range 0,05 s ... 100 h

Output relay

2 potential free change over contacts
250 Vac 8 A

Indicators

Green LED ON: indication of supply voltage
Green LED flashes: indication of time
Yellow LED ON/OFF: indication of relay output



MFT SU22P

Connecting voltage

12 ... 240 Vac/dc -10% +10%
48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data

Selectron® MFT	Article no.
MFT SU22S	41140010
MFT SU22P	41140012
(Order data see chapter 1)	

Multifunctional time delay relay

MFT SU22S, MFT SU22P

Technical data	MFT SU22S	MFT SU22P
Nominal consumption		
12 ... 240 Vac/dc	6 VA / 2 W	
Control contact / Voltage controlled		
Parallel switching of loads possible	yes	no
Parallel minimum load	1 VA or 0,5 W	–
Voltage dependence:	The potential between connections 2 and 5 must cover 90% of the supply voltage	Potential free control contact between connections 6 and 7 The internal voltage on these connectors is on the same potential as supply voltage
Connecting length between connections 2 and 5:	10 m or capacity <10 nF	–
Connecting length between connections 6 and 7:	At 230 VAC 10 VDC <1 mA	10 m or capacity <10 nF
Resistance	>1 MΩ (contact K2 open)	–
Rest current at parallel load:	approx. 2 mA at contact K2 open	–
Accuracy		
Base accuracy	±1% of scale limit	
Repetition accuracy	<5 ms or <0,5%	
Adjustment accuracy	≤5% of scale limit	
Temperature influence	≤0,01% / °C	
Voltage influence		
Reaction times		
Operating return time K1	max. 60 ms / 30 ms	
Reaction time K2	max. 30 ms	
Min. pulse/pause time K2	ac 100 ms / dc 50 ms	
Recovery time	max. 100 ms	

Type key

MFT S U 2 2 S -	
Construction	Special functions
S Pluggable 11 poles	E External Potentiometer
Functions	Control
U Universal	S Voltage control
A Without auxiliary voltage	P Potential free
T Cycling timer	
S Star-delta	
D Digital	
Output	Connecting range
1 1 changer	1 24 Vdc/ac and 110 ... 240 Vac
2 2 changers	2 12 ... 240 Vac/dc
3 1 changer / 1 immediate contact	3 24 ... 240 Vac/dc
4 1 changer / 1 closing contact	
5 1 closing / 1 opening contact	

Multifunctional time delay relay

MFT SU22S, MFT SU22P

Function descriptions

E - Delay on


When the supply voltage U (K1 closed) is applied, the set interval t begins (green LED U/t flashes). After the interval t



has expired (green LED U/t illuminated) the output relay switches into on-position (yellow LED illuminated). This status remains until the supply voltage U (K1 opened) is interrupted. If the supply voltage U is interrupted before expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage U (K1 closed) is next applied.

E - Delay on - version with control contact as opening contact


The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control



contact K2 is opened, the set interval t begins (green LED U/t flashes). After the interval t has expired the output relay switches into on-position (yellow LED illuminated). If the control contact K2 is closed before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

A - Delay off


The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t



illuminated). When the control contact K2 is closed, the output relay R switches into on-position (yellow LED illuminated). If the control contact K2 is opened, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). If the control contact K2 is closed again before the interval t (green LED U/t illuminated) has expired, the interval already expired is erased and is restarted with the next cycle.

I2 - Pulse extension with control contact


The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t



illuminated). When the control contact K2 is closed, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact K2 can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

W2 - Wiping on trailing edge


The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t



illuminated). Closing the control contact K2 has no influence on the condition of the output relay R. When the control contact K2 is opened, the output relay switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated), the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact K2 can be operated any number of times. A further cycle can only be started when a cycle run has been completed.

E1 - Delay on with control contact

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t



illuminated). When the control contact K2 is closed, the set interval t begins (green U/tLED flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the control contact K2 is opened. If the control contact K2 is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.


Multifunctional time delay relay

MFT SU22S, MFT SU22P

Function descriptions

I1 - Pulse limitation timer voltage control


When supply voltage U (K1 closed) is applied, the output relay R switches into on-position (yellow LED illuminated)



and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). This status remains until the supply voltage (K1 opened) is interrupted. If the supply voltage is interrupted before the interval t has expired, the output relay switches into off-position. The interval t already expired is erased and is restarted when the supply voltage is next applied.

B2 - Cycling timer starting on a pause


When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has




expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered in the ratio 1:1 until the supply voltage is interrupted.

Connection

MFT SU22S




MFT SU22P

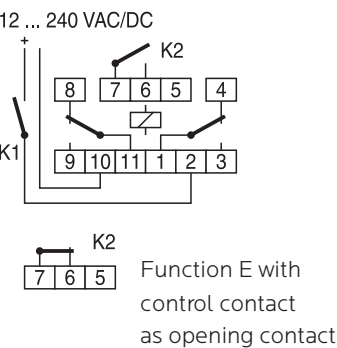


Load limit curves

MFT SU22S, MFT SU22P



Dimensions



Multifunctional time delay relay

MFT U31S, MFT U41SE



MFT U31S

- **8 Functions, 8 time ranges**
- **Multivoltage:**
24 Vac / dc
110 ... 240 Vac
- **2 output contacts**

Functions

- E** Delay on
- E** Delay on - version with control contact as opening contact
- A** Delay off without auxiliary voltage
- B2** Cycling timer starting on a pause
- S1** Stop monitoring with control contact
- I1** Pulse limitation timer voltage control
- I2** Pulse extension with control contact
- W2** Wiping on trailing edge
- E1** Delay on with control contact

Time end ranges

Adjustment range 0,05 s ... 30 days (MFT U31S)

Adjustment range 0,05 s ... 10 days (MFT U41SE)

Output relay

1 change over and 1 immediate contact (MFT U31S)

1 change over and 1 closing contact potential free (MFT U41SE)

250 Vac 5 A units close together, 8 A units not close together



MFT U41SE

Indicators

Green LED ON: indication of supply voltage

Green LED flashes: indication of time

Yellow LED ON/OFF: indication of relay output

Connecting voltage

24 Vac/dc $\pm 10\%$ and 110 ... 240 Vac -15% +10%

48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data


Selectron® MFT	Article no.
MFT-U31S	41140003
MFT-U41SE	41140004
(Order data see chapter 1)	

Multifunctional time delay relay

MFT U31S, MFT U41SE

Technical data		
Nominal consumption MFT U31S, MFT U41SE		
	24 Vac/dc	1,5 VA / 1 W
	110 Vac	2 VA / 1 W
	240 Vac	11 VA / 1,4 W
Control contact / Voltage controlled		
	Parallel switching of loads possible	
	Parallel minimum load	1 VA or 0,5 W
	Voltage dependence:	The potential between connections 2 and 5, resp. 7 and 5, must cover 90% of the supply voltage
	Connecting length between connections 10 and 5:	10 m or capacity <10 nF
	Resistance	>1 MΩ (contact K2 open)
	Rest current at parallel load:	approx. 2 mA at contact K2 open
	External Potentiometer 1 MΩ	Voltage on contact 6 and 8 24 VAC/DC resp. 110 ... 240 VAC
Accuracy		
	Scale limit stops	±0,5%
	Repeatability	
	of the scale limit at constant conditions	±5 ms or <0,5%
	Adjustment accuracy	<5% of scale limit
	Temperature influence	≤0,01% / °C
Reaction times		
	Operating return time K1	max. 60 ms / 30 ms
	Reaction time K2	max. 30 ms
	Min. pulse/pause time K2	ac 50 ms / dc 50 ms
	Recovery time	max. 100 ms

Type key

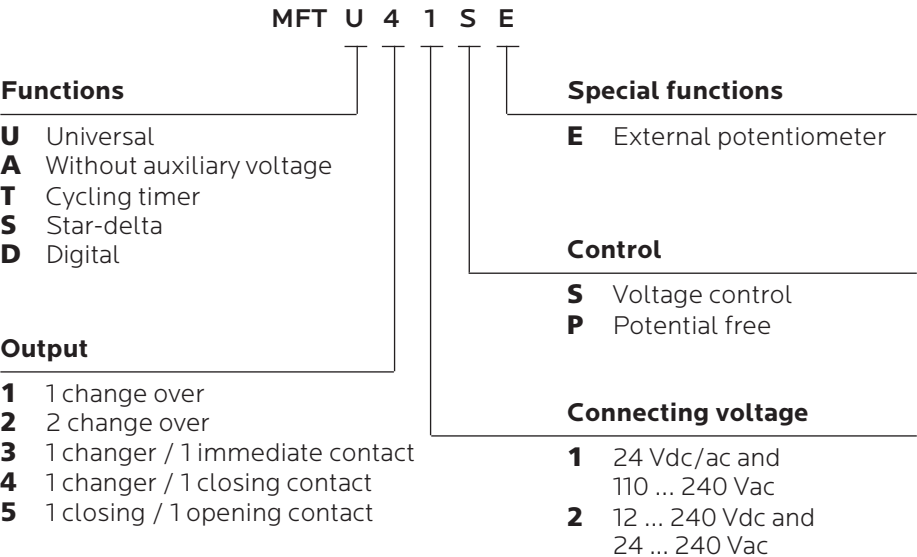

Multifunctional time delay relay

MFT U31S, MFT U41SE

Function descriptions

E - Delay on


When the supply voltage U (K1 closed) is applied, the set interval t begins (green LED U/t flashes). After the interval t



has expired (green LED U/t illuminated) the output relay switches into on-position (yellow LED illuminated). This status remains until the supply voltage U (K1 opened) is interrupted. If the supply voltage U is interrupted before expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage U (K1 closed) is next applied.

E - Delay on - version with control contact as opening contact


The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control



contact K2 is opened, the set interval t begins (green LED U/t flashes). This status remains until the control contact K2 is opened again. If the control contact K2 is closed before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

A - Delay off

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t illuminated).




When the control contact K2 is closed, the output relay R switches into on-position (yellow LED illuminated). If the control contact K2 is opened, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated).

If the control contact K2 is closed again before the interval t (green LED U/t illuminated) has expired, the interval already expired is erased and is restarted with the next cycle.

B2 - Cycling timer starting on a pause


When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has



expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered in the ratio 1:1 until the supply voltage is interrupted.

S1 - Stop monitoring with control contact

Us is permanently connected via K1. The output relay switches immediately, independently of K2 (green LED



U/t and yellow LED illuminated) and after that the first positive edge of K2 starts the time t (green LED flashes). Each additional positive edge of K2 which arrives before the expiry of the time sequence starts the time t again and the output relay stays in active mode. After expiry of the time t the output relay switches into off-position (yellow LED not illuminated) and the unit is interlocked against all following edges of K2 (memory). The sequence can only be restarted by a new opening and closing of K1.

I1 - Pulse limitation timer voltage control

When supply voltage U (K1 closed) is applied, the output relay R switches into on-position (yellow LED



illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). This status remains until the supply voltage (K1 opened) is interrupted. If the supply voltage is interrupted before the interval t has expired, the output relay switches into off-position. The interval t already expired is erased and is restarted when the supply voltage is next applied.


Multifunctional time delay relay

MFT U31S, MFT U41SE

Function descriptions

I2 - Pulse extension with control contact

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t illuminated). When the control contact K2 is closed, the




output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated).

During the interval, the control contact K2 can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

W2 - Wiping on trailing edge

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t illuminated).

Closing the control contact K2 has no influence on the




condition of the output relay R. When the control contact K2

is opened, the output relay switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated), the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact K2 can be operated any number of times. A further cycle can only be started when a cycle run has been completed.

E1 - Delay on with control contact

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t illuminated).



When the control contact K2 is closed, the set interval t





begins (green U/tLED flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the control contact K2 is opened. If the control contact K2 is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

Connection

MFT U31S



MFT U41SE




Multifunctional time delay relay


MFT U31S, MFT U41SE

Load limit curves


MFT U31S



MFT U41SE




Dimensions



Multifunctional clock-pulse generator relay

MFT ST22S



MFT ST22S

- **7 Function, 7 timer ranges**
- **Multivoltage:**
12 ... 240 Vac/dc
- **2 Output contacts**

Functions

- TP** Cycling timer relay beginning on a pause
- TI** Cycling timer relay beginning on a pulse
- EA** Delay on and delay off
- EI1** Input delay pulse limitation timer voltage control
- EI3** Input delay pulse limitation with control contact
- EI2** Wiping on leading and trailing edge with control contact
- I3** Pulse detection

Time end ranges

Adjustable 0,05 s ... 100 h

Output relay

2 potential free change over contact

250 Vac 8 A

Indicators

- Green LED ON: indication of supply voltage
- Green LED flashes slowly: indication of time t1
- Green LED flashes fast: indication of time t2
- Yellow LED ON/OFF: indication of relay output

Connecting voltage

12 ... 240 Vac/dc -10% +10%

48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data

Selectron® MFT	Article no.
MFT ST22S	41140006
(Order data see chapter 1)	

Multifunctional clock-pulse generator relay

MFT ST22S

Technical data	
Nominal consumption	
12 ... 240 Vac/dc	6 VA / 2 W
Control contact / Voltage controlled	
Parallel switching of loads possible	
Parallel minimum load	1 VA or 0,5 W
Voltage dependence:	The potential between connections 2 and 5 must cover 90% of the supply voltage.
Connecting length between connections 2 and 5:	10 m or capacity <10 nF
Resistance	>1 MΩ (contact K2 open)
Rest current at parallel load:	approx. 2 mA at contact K2 open
Accuracy	
Base accuracy	±1% of scale limits
Repetition accuracy	±5ms or <0,5%
Adjustment accuracy	<5% of scale limits
Temperature influence	≤0,01% / °C
Voltage influence	–
Reaction times	
Operating/return time K1	max. 60 ms / 30 ms
Reaction time K2	max. 30 ms
Min. pulse/pause time K2	ac 100 ms / dc 50 ms
Recovery time	max. 100 ms

Type key

MFT S T 2 2 S -	
Construction S Pluggable 11 poles	Special functions E External Potentiometer
Functions U Universal A Without auxiliary voltage T Cycling timer S Star-delta D Digital	Control S Voltage control P Potential free
Output 1 1 changer 2 2 changers 3 1 changer / 1 immediate contact 4 1 changer / 1 closing contact 5 1 closing / 1 opening contact	Connecting range 1 24 Vdc/ac and 110 ... 240 Vac 2 12 ... 240 Vac/dc 3 24 ... 240 Vac/dc

Multifunctional clock-pulse generator relay

MFT ST22S

Function descriptions

TP - Cycling timer relay beginning on a pause

When the supply voltage U (K1 closed) is applied, the set interval t1 begins (green LED U/t flashes slowly). After the




interval t1 has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated).

The output relay is triggered in the ratio of the two set intervals until the supply voltage U (K1 opened) is interrupted.

TI - Cycling timer relay beginning on a pulse


When the supply voltage U (K1 closed) is applied, the



output relay R switches into on-position (yellow LED illuminated) and the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay switches into off-position (yellow LED not illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into on-position again (yellow LED illuminated).

The output relay is triggered in the ratio of the two set intervals until the supply U (K1 opened) voltage is interrupted.

EA - Delay on and delay off



The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device (green LED U/t illuminated). When the control contact K2 is closed, the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay R switches into on-position (yellow LED illuminated). When the control contact K2 is opened, the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated).

If the control contact K2 is opened before the interval t1 has

expired, the interval already expired is erased and is restarted with the next cycle.

EI1 - Input delay pulse limitation timer voltage control


When the supply voltage U (K1 closed) is applied, the set interval t1 begins (green LED U/t flashes slowly). After the



interval t1 has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated). If the supply voltage is interrupted before the interval t1+t2 has expired, the interval already expired is erased and is restarted when the supply voltage is next applied.

EI3 - Input delay pulse limitation timer with control contact


The supply voltage U (K1 closed) must be constantly applied to the device (green LED U/t illuminated). When the control contact K2 is closed, the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output



relay switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact K2 can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

EI2 - Wiping on leading and trailing edge with control contact

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control



contact K2 is closed, the output relay R switches into on-position (yellow LED illuminated) and the set interval t1 begins (green LED U/t flashes slowly). After the interval t1

Multifunctional clock-pulse generator relay

MFT ST22S


Function descriptions

has expired, the output relay R switches into off-position (yellow LED not illuminated).

If the control contact is opened, the output relay again switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times.

I3 - Pulse detection


When the supply voltage U (K1 closed) is applied, the set interval t1 begins (green LED U/t flashes slowly) and the



output relay R switches into on-position (yellow LED illuminated). After the interval t1 has expired, the set interval t2 begins (green LED U/t flashes fast). For the output relay to remain in on-position, the control contact K2 must be closed and reopened within the set interval t2. If this does not occur, the output relay R switches into off-position (yellow LED not illuminated) and all further pulses at the control contact K2 are ignored.To restart the function, the supply voltage must be interrupted and reapplied.


Connection

MFT ST22S




Load limit curve

MFT ST22S



Dimensions



Multifunctional clock-pulse generator relay

MFT T51SE



MFT T51SE

- **5 Function, 8 timer ranges**
- **Multivoltage:**
24 Vac/dc and 110 ... 240 Vac
- **2 Output contacts**

Functions

- TP** Cycling timer relay beginning on a pause
- TI** Cycling timer relay beginning on a pulse
- EA** Delay on and delay off
- EI1** Input delay pulse limitation timer voltage control
- EI2** Input delay pulse with control contact

Time end ranges

Adjustable 0,05 s ... 10 days

Output relay

1 closing contact and 1 opening contact potential free
250 Vac 5 A units close together 8 A units not close together

Indicators

- Green LED ON: indication of supply voltage
- Green LED flashes slowly: indication of time t1
- Green LED flashes fast: indication of time t2
- Yellow LED ON/OFF: indication of relay output

Connecting voltage

24 Vdc $\pm 10\%$, 24 Vac and 110 ... 240 Vac $-15\% +10\%$
48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data


Selectron® MFT	Article no.
MFT T51SE	41140007
(Order data see chapter 1)	

Multifunctional clock-pulse generator relay

MFT T51SE

Technical data		
Nominal consumption		
	24 Vac/dc	1,5 VA / 1 W
	110 Vac	2 VA / 1 W
	230 Vac	8 VA / 1,3 W
Control contact / Voltage controlled		
	Parallel switching of loads possible	
	Parallel minimum load	1 VA or 0,5 W
	Voltage dependence:	The potential between connections 2 and 5, resp. 7 and 5, must cover 90% of the supply voltage.
	Connecting length between connections 10 and 5:	10 m or capacity <10 nF
	Resistance	>1 M Ω (contact K2 open)
	Rest current at parallel load:	approx. 2 mA at contact K2 open
Accuracy		
	Scale limit stops	$\pm 0,5\%$
	Repeatability of the scale limit at constant conditions	$\pm 5\text{ms}$ or <0,5%
	Adjustment accuracy	<5%
	Temperature influence	$\leq 0,05\% / ^\circ\text{C}$
Reaction times		
	Operating/return time K1	max. 60 ms / 30 ms
	Reaction time K2	max. 30 ms
	Min. pulse/pause time K2	ac 50 ms / dc 50 ms
	Recovery time	max. 200 ms

Type key

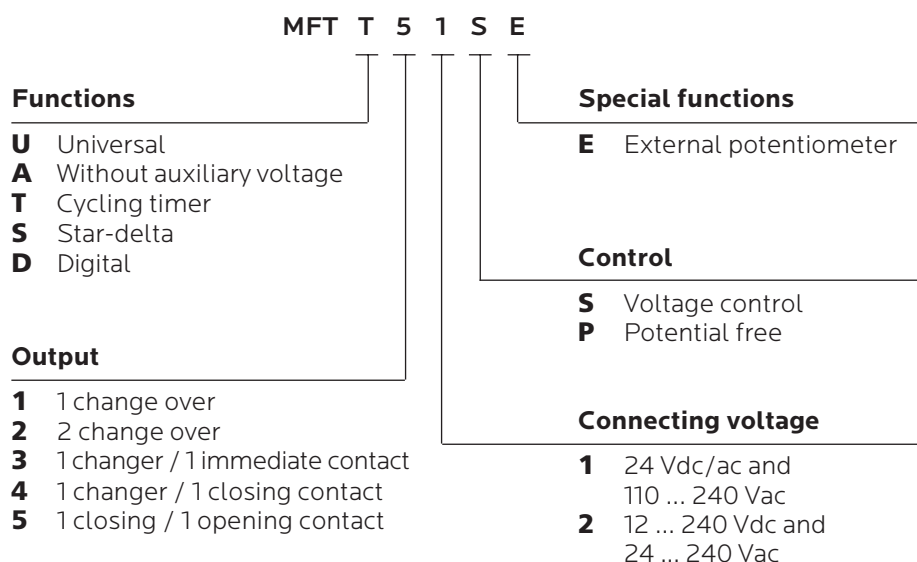


Multifunctional clock-pulse generator relay

MFT T51SE

Function descriptions

TP - Cycling timer relay beginning on a pause


When the supply voltage U (K1 closed) is applied, the set interval t1 begins (green LED U/t flashes slowly).



After the interval t1 has expired, the output relay switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered in the ratio of the two set intervals until the supply voltage U (K1 opened) is interrupted.

TI - Cycling timer relay beginning on a pulse

When the supply voltage U (K1 closed) is applied, the output relay R switches into on-position (yellow LED




illuminated) and the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay switches into off-position (yellow LED not illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into on-position again (yellow LED illuminated).

The output relay is triggered in the ratio of the two set intervals until the supply U (K1 opened) voltage is interrupted.

EA - Delay on and delay off

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device



(green LED U/t illuminated). When the control contact K2 is closed, the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay R switches into on-position (yellow LED illuminated). When the control contact K2 is opened, the set interval t2 begins (green LED U/t flashes fast).

After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated). If the control contact K2 is opened before the interval t1 has expired, the interval already expired is erased and is restarted with the next cycle.

EI1 - Input delay pulse limitation timer voltage control

When the supply voltage U (K1 closed) is applied, the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay



switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED U/t flashes fast). After the interval t2 has expired, the output relay switches into off-position (yellow LED not illuminated). If the supply voltage is interrupted before the interval t1+t2 has expired, the interval already expired is erased and is restarted when the supply voltage is next applied.

EI2 - Input delay pulse with control contact

The supply voltage U (K1 closed or permanently connected) must be constantly applied to the device




(green LED U/t illuminated). After closing of K2, the set interval t1 begins (green LED U/t flashes slowly). After the interval t1 has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 (green LED U/t flashes fast) begins. After the set interval t2 has expired the output relay switches into off-position (yellow LED not illuminated). During the intervals t1 or t2, the control contact K2 can be operated any number of times. A further cycle can only be started when the running cycle has been completed.

Multifunctional clock-pulse generator relay

MFT T51SE


Connection

MFT T51SE

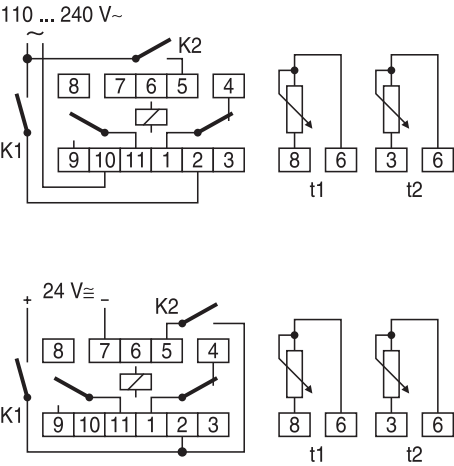


Load limit curve

MFT T51SE



Dimensions



Delay off without supply voltage

MFT SA23S



MFT SA23S

- **5 Function, 4 time ranges**
- **Multivoltage:**
24 ... 240 Vac/dc
- **2 Output contacts**

Functions

- E** On delay
- A** Off delay without auxiliary voltage
- W2** Wiping on trailing edge voltage control (non-resetting on voltage failure)
- I1** Pulse limitation timer voltage control (non-resetting on voltage failure)
- W3** Wiping on leading and trailing edge voltage control (non-resetting on voltage failure)

Time end ranges

Adjustable 0,1 s ... 3 min.

Output relay

2 changers potential free
250 Vac / 8 A

Indicators

Green LED ON: indication of supply voltage

Connecting voltage

24 ... 240 Vac/dc, ac: -15% +10%, dc: -10% +10%
48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data

Selectron® MFT	Article no.
MFT SA23S	41140008
(Order data see chapter 1)	



Note:


After transport the output relay maybe in any position.
The correct operation will be given after the first cycle.

Delay off without supply voltage

MFT SA23S

Technical data		
Nominal consumption		
	ac	1 VA / 0.5 W
	dc	0.7 VA / 0.7 W
Accuracy		
	Base accuracy	± 1% of scale limit ≤ 10% for time range 1s
	Repetition accuracy	1% or 100 ms
	Adjustment accuracy	< 5% of scale limit
	Temperature influence	≤ 0,02% / °C
Reaction time		
	Recovery time	100 ms

Type key

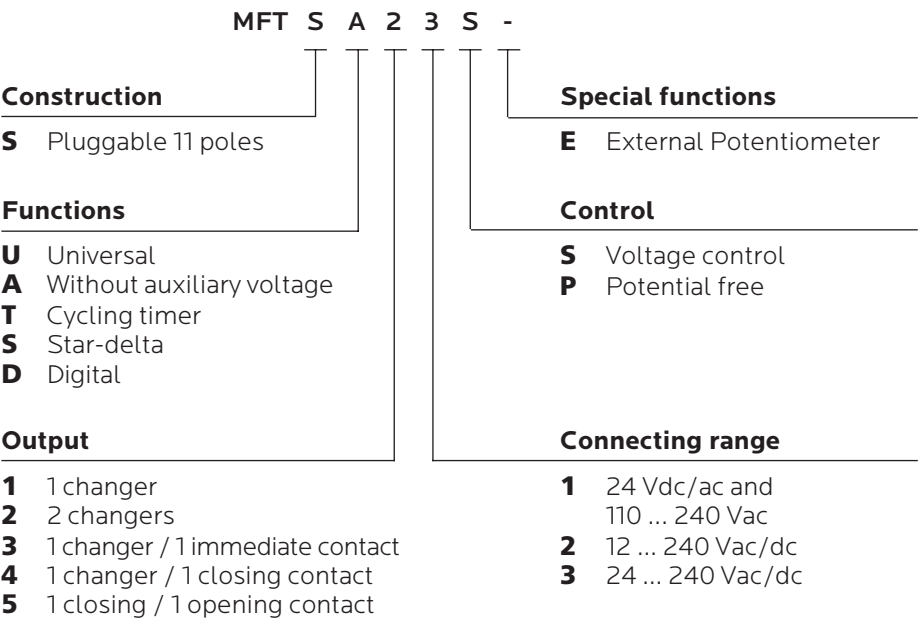

Delay off without supply voltage

MFT SA23S

Function descriptions

E - On delay

Activation by U_s via K1. When K1 closes, the set interval t begins (green LED U illuminated).



After the interval t has elapsed, the output relay picks up and remains in the working position until K1 is opened again. Interrupting U_s during the interval t causes a reset.

A - Off delay

Activation by U_s via K1. The output relay picks up after K1 closes. If K1 is opened again, the set interval t begins (green LED U not illuminated).



After the interval t has elapsed, the output relay drops back out to its rest position. Operating K1 during the interval t causes a time reset.

I1 - Pulse limitation timer voltage control

Activation by U_s via K1. When K1 closes, the output relay picks up immediately and the set interval t begins (green LED U illuminated).



After the interval t has elapsed, the output relay drops back out to its rest position. This condition is maintained until U_s is interrupted. Interrupting U_s before the interval t has elapsed means that the output relay remains picked up until the interval t has fully elapsed.

W2 - Wiping on trailing edge voltage control

Activation by U_s via K1. The output relay remains dropped out after K1 closes. As soon as K1 is opened, the output relay picks up and the set interval t begins (green LED U not illuminated).




After the interval t has elapsed, the output relay drops out. Closing K1 before the interval t has elapsed means that the

output relay remains picked up until the interval t has fully elapsed.

W3 - Wiping on leading and trailing edge voltage control

Activation by U_s via K1. When K1 closes, the output relay picks up and the set interval t begins (green LED U illuminated).

After the interval t has elapsed, the output relay drops out. As soon as K1 is opened, the output relay picks up and the set interval t begins (green LED U not illuminated).




After the interval t has elapsed, the output relay drops out. Interrupting or re-applying U_s before the interval t has elapsed means that the output relay remains picked up until the interval t has fully elapsed.

Delay off without supply voltage

MFT SA23S


Connection

MFT SA23S




Load limit curve

MFT SA23S



Dimensions



Star-delta relay

MFT SS22S



MFT SS22S

- 1 Function, 4 time ranges
- Multivoltage:
12 ... 240 Vac/dc
- 2 Output controls

Functions

S Star-delta

Time end ranges

Star times 500 ms - 10 s, 1,5 s - 30 s, 3 s - 1 min., 9 s - 3 min.

Change over time 40 ms, 60 ms, 80 ms, 100 ms

Output relay

2 potential free change over contacts

250 Vac 8 A

Indicators

Green LED ON: indication of supply voltage

Green LED flashes: indication of time period - start-up time

Yellow LED ON/OFF: indication of star-contactor

Connecting voltage

12 ... 240 Vac/dc -10% +10%

48 ... 63 Hz, 100% duration of operation, IEC class 1c

Reference data

Selectron® MFT	Article no.
MFT SS22S	41140009
(Order data see chapter 1)	

Star-delta relay

MFT SS22S

Technical data		
Nominal consumption		
	12 ... 240 Vac/dc	6 VA / 2 W
	Residual ripple to dc	10%
	Dop-out voltage	> 30% of the supply voltage
Accuracy		
	Repetition accuracy	±5 ms or <0,5%
	Adjustment accuracy	<5%
	Temperature influence	≤0,01% / °C
	Base accuracy	±1% of scale limit
	Voltage influence	–
Reaction time		
	Recovery time	100 ms

Type key

MFT		S	S	2	2	S	-		
Construction				Special functions					
S Pluggable 11 poles				E External Potentiometer					
Functions				Control					
U Universal				S Voltage control					
A Without auxiliary voltage				P Potential free					
T Cycling timer									
S Star-delta									
D Digital									
Output				Connecting range					
1 1 changer				1 24 Vdc/ac and 110 ... 240 Vac					
2 2 changers				2 12 ... 240 Vac/dc					
3 1 changer / 1 immediate contact				3 24 ... 240 Vac/dc					
4 1 changer / 1 closing contact									
5 1 closing / 1 opening contact									


Star-delta relay

MFT SS22S

Function descriptions

S - Star-delta start-up


When the supply voltage U is applied, the star-contact switches into on-position (yellow LED illuminated) and the set star-time Y begins (green LED U/t flashes).



After the interval Y has expired (green LED U/t illuminated) the star-contact switches into off-position (yellow LED not illuminated) and the set transit-time ($Y \rightarrow \Delta$) begins. After the interval Δ has expired the contact for the delta-contactor switches into on-position (green LED U/t illuminated). To restart the function the supply voltage must be interrupted and re-applied.


Connection

SS22S



Load limit curve


MFT SS22S




Star-delta relay

MFT SS22S

Dimensions




Plug in socket




Plug in socket 11 poles	Article no.
SSK 11 N	41910006
(Order data see chapter 1)	

External potentiometer




Potentiometer POTSET	
Resistor	1 M Ω
Article no.	41920033
(Order data see chapter 1)	

Potentiometer, turning knob and scale are included in the delivery



Potentiometer EXPOT 1	
Resistor	1 M Ω
Angle of rotation	295 °
Front protection	IP 64
Mounting diameter	22,5 mm
Connection	Screw terminals
Article no.	41920034
(Order data see chapter 1)	



Technical safety advice

This manual contains the information necessary for the correct utilisation of the products described therein. It is intended for technically qualified persons who are involved as either

- planning engineers familiar with the safety concepts of automation technology;
- or, operating personnel, who have been instructed in handling automation equipment and have a knowledge of the contents of this manual concerning operation;
- or, installation and servicing personnel possessing the necessary training to repair such an automation system or who have the authority to put such circuits and equipment/systems into operation, to earth or label them according to the relevant safety standards.

The products are constructed, manufactured and tested in compliance with the relevant VDE standards, VDE specifications and IEC recommendations.

Danger warning

These warnings serve both as a guide for those persons involved in a project and as safety advice to prevent damage to the products themselves or to associated equipment.

Due to advancements in technology, the wiring diagram on the actual device may be different than shown in this catalogue. In all instances where the actual device diagram is different, the wiring diagram on the device must be used when electrical connections are made.

Correct utilisation, configuration and assembly

The equipment is to be used only for the applications stated in the catalogue and technical literature, and only in conjunction with auxiliary equipment and devices that are recommended or approved by Selectron Systems Ltd.

Further, it should be noted that:

- the automation equipment must be disconnected from any power supply before it is assembled, disassembled or the configuration modified.

- Solid state electronic switches must not be tested with incandescent lamps or connected to a load that exceeds its rating.
- trouble-free and safe operation of the products requires correct transportation as well as appropriate storage, assembly and wiring.
- the systems may only be installed by trained personnel. In doing so, the relevant requirements contained in VDE 0100, VDE 0113, IEC 364, etc. must be complied with.

Prevention of material damage or personal injury

Additional external safety devices or facilities must be provided wherever significant material damage or even personal injury could result from a fault occurring in an automation system. A defined operating status must be ensured or forced by such devices or facilities (e.g. by independent limit switches, mechanical interlocks, etc.).

Advice concerning planning and installation of the products

- The safety and accident prevention measures applicable to a specific application are to be observed.
- In the case of mains-operated equipment, a check is to be made before putting it into operation to ensure that the preset mains voltage range is suitable for the local supply.
- In the case of a 24 V supply, care must be taken to ensure sufficient electrical insulation of the secondary side. Use only mains power supply units that conform to IEC 364-4-41 or HD 384.04.41 (VDE 0100 Part 410).
- Automation systems and their operating elements are to be installed in such a way that they are sufficiently protected against accidental operation.

Warranty

Selectron Systems Ltd. warrants its products to be free from defects in material and workmanship for a period of one year from the date of shipment. All claims under this warranty must be made within thirty (30) days of the discovery of the defect, and all defective products must be returned at the buyer's expense. Buyer's sole and exclusive right will be limited to, at the option of Selectron Systems Ltd., the repair or replacement by Selectron Systems Ltd., of any defective products for which a claim is made.

In all other matters please refer to the "General terms of business" concerning Selectron Systems Ltd.

Note

The information given in this documentation corresponds to the state of development at the time of going to press and is therefore not binding. Selectron Systems Ltd. reserves the right to make alterations in the interests of technical advancement or product improvement at any time without giving reasons for doing so.

Prescriptions and standards

Mechanical data	
Housings in self-extinguishing plastic material. Protection mode IP 40	
Mounting: snapping mode:	Fixing on profile rail according DIN 46277/3 (EN 50 022)
	Connection via contact protected terminals up to 4 mm ² , protecting mode IP 20
Mounting: plugable mode:	Fixing and connection via 11 pole screw or soldering plug socket
	Pin arrangement and connection mark according IEC67-1-18a
Environmental conditions	
Admissible environmental temperatures from -25 °C ... +55 °C (corresponds IEC 68-1)	
Storage and transport temperature from -25 °C ... +70 °C	
Application class HVF according DIN 40040, pr IEC 1812-1 (1994) and IEC 721-3-3 class 3K3	
Output relay	
Electrical lifetime:	230 Vac, min. 400'000 switching cycles at 5 A ohmic.
Mechanical lifetime:	min. 30 x 10 ⁶ switching cycles
Contact material	AgNi 0,15
Supply voltage	
Frequency range	48 ... 63 Hz
Duty cycle	100%, IEC class 1c
Protection	
Protection of the unit	8 A fast
Terminals	
Contact protection according VDE 0106 and VBG 4	
Terminal arrangement and connecting mark according DIN 46 199	
Terminal type:	sleeve with indirect screw pressure
Wire to connect:	rigid or flexible
Connecting limit:	4 mm ²
Terminal variants:	1 wire 0,5 mm ² ... 2,5 mm ² with/without wire end covers
	1 wire 4 mm ² without wire end covers
	2 wires 0,5 mm ² ... 1,5 mm ² with/without wire end covers
	2 wires 2,5 mm ² flexible without wire end covers
max. screw in torque: 1,0 Nm	
Terminal screw for screw driver or Pozi drive PZ-1	
Insulation	
Isolation nominal voltage:	250 Vac (corresponds to IEC 664-1)
Rating surge voltage:	4 kV, over-voltage category III, corresponds to IEC 664-1
Electromagnetic compatibility	
Electrostatic discharge: Level 3, 6 kV contact, 8 kV air (corresponds to IEC 1000-4-2)	
High frequency electromagnetic fields: Level 3, 10 V/m (corresponds to IEC 1000-4-3)	
Fast transients: Level 4, 4 kV / 2,5 kHz, 5/50 ns (corresponds to IEC 1000-4-4)	
Lightning discharge: Level 3, 2 kV com., 1 kV dif., (corresponds to IEC 1000-4-5)	
Cable running disturbances inducted by HF fields: Level 3, 10 V RMS (corresponds to IEC 1000-4-6)	
Spurious radiation net and aerial network: Class B (corresponds to CISPR 22)	
Prescriptions	
Air and leakage paces:	VDE 0110iGr. C/250
Test voltage:	VDE 0435 2000Vac
Low voltage directions according to IEC 664-1	
EMC emissions:	EN 50 081-1 and EN 55 022 class B
EMC interference stability:	Voltage impact strength according to IEC 1000-4-5
Burst:	EN 50 082-2, EN 61 812-1 (level 3)
ESD:	IEC 1000-4-2
HF over metallic circuits:	EN 50 082-2, ENPr 50141
Electro magnetic HF field according to EN 50 082-2, ENPr 50140 and ENPr 50204	
Production standard:	according to ISO 9001